

# SPECIFICATION SUBMITTAL SHEET



### **FEATURES**

Sizes: 1/2" 13/4" 11 11/4" 11/2" 2"

Maximum working water pressure

Maximum working water temperature

Reduced pressure range (standard)

Factory preset

Hydrostatic test pressure

CPVC tailpiece: Max. hot water temp.

11/4" 11/2" 2"

300 psi

140°F

25 psi to 75 psi

50 psi

300 psi

140°F

140°F

**OPTIONS** (Suffixes can be combined)

- standard with 20 mesh strainer screen

Cold water rated temp.

- □ C copper sweat connection (3/4" thru 2")
  □ DM double male meter tailpiece connection (3/4);
- 1" National Hose Thread fits 5/8" x 3/4" and 3/4" water meters (no union included)
- HR 75 psi to 125 psi spring range, factory set at 85 psi
- ☐ HLR 10 psi to 125 psi spring range, factory set at 50 psi
- ☐ HT 180°F maximum temp
- ☐ L less integral by-pass check valve
- □ LU less union assembly, female x female
- □ LPV 180°F maximum temp with 10 psi to 35 psi spring range, factory set at 20 psi
- □ LPC 140°F maximum temp with 10 psi to 35 psi spring range, factory set at 20 psi (2" field set only)
- SC sealed cage bell housing and stainless steel adjustment screw
- □ 610 400 psi inlet rating and 75 psi to 125 psi spring range, factory set at 85 psi
- P tapped and plugged for gauge
- □ CPVC CPVC tailpiece connection (1/2"-1")
- ☐ G Tapped with gauge
- ☐ CH Chrome stem & plunger

## **APPLICATION**

Designed for installation on potable water lines to reduce high inlet pressure to a lower outlet pressure. The integral strainer makes this device most suitable for residential and commercial water systems requiring frequent cleaning because of sediment and debris. The direct acting integral by-pass design prevents buildup of excessive system pressure caused by thermal expansion. The balanced piston design enables the regulator to react in a smooth and responsive manner to changes in system flow demand, while at the same time, providing protection from inlet pressure changes.

# STANDARDS COMPLIANCE

- ASSE® Listed 1003
- IAPMO® Listed
- CSA® Certified
- City of Los Angeles Approved

#### **MATERIALS**

73.4°F @ 400 psi

Main valve body Cast Bronze ASTM B 584 Access covers Cast Bronze ASTM B 584

Brass ASTM B 16

Fasteners Stainless Steel, 300 Series Stem & plunger Cast Bronze ASTM B 584

Brass ASTM B 16


Elastomers Buna Nitrile, (FDA Approved)

EPDM, (FDA Approved)

Cap gaskets Natural Vulcanized Fibre

Acetal (Delrin™), NSF Listed

Strainer screen Stainless Steel, 300 Series




## **DIMENSIONS & WEIGHTS (do not include pkg.)**

SIZE		CONNECTIONS	DIMENSIONS (approximate)								WEIGHT	
			Α		В		С		D		VVEIGHT	
in.	mm		in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg.
1/2	15	SINGLE UNION	5 1/2	133	6 1/4	159	1 1/4	32	2 3/4	70	3	1.5
1/2	15	LESS UNION	4 1/2	114	6 1/4	159	1 1/4	32	2 3/4	70	3	1.5
3/4	20	SINGLE UNION	5 5/16	135	5 1/2	140	1 1/4	32	2 3/4	70	3	1.5
3/4	20	LESS UNION	4 7/8	121	5 1/2	140	1 1/4	32	2 3/4	70	3	1.5
1	25	SINGLE UNION	6 1/8	156	7 1/4	184	2	51	3 3/8	86	5	2.5
1	25	LESS UNION	5 3/4	146	7 1/4	184	2	51	3 3/8	86	5	2.5
1 1/4	32	SINGLE UNION	7 1/8	181	8	203	2	51	3 7/8	100	7	3.0
1 1/2	40	SINGLE UNION	9 1/8	232	10	254	2 1/2	64	5	127	13	6.0
2	50	SINGLE LINION	10 1/4	260	12	305	3	76	6 1/2	165	21	9.5


DOCUMENT #: REG-600

REVISION: 10/10

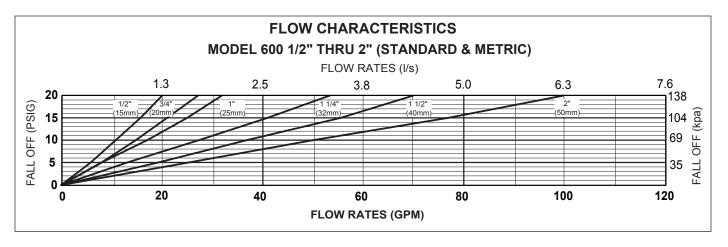

## TYPICAL INSTALLATION

Local codes shall govern installation requirements. Unless otherwise specified, the assembly shall be mounted in accordance with the latest edition of the Uniform Plumbing Code. The Model 600 may be installed in any position. If installed in a pit, vault or inside application, specify the "SC" sealed cage option. Multiple installations are recommend for wide demand variations or where the desired pressure reduction is more than 4 to 1 (i.e.: 200 psi inlet reduced to 50 psi outlet). CAUTION: Anytime a reducing valve is adjusted, a pressure gauge must be used downstream to verify correct pressure setting. Do not bottom adjustment bolt on bell housing.

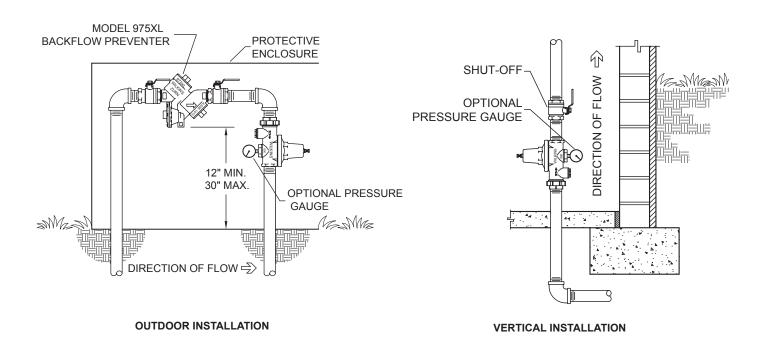

# **SPECIFICATIONS**

The Pressure Reducing Valve shall consist of a bronze body and bell housing, shall have separate access covers for the plunger and strainer screen and shall have a bolt to adjust the downstream pressure. The Pressure Reducing Valve shall be of the balanced piston design and shall reduce pressure in both flow and no-flow conditions. The bronze bell housing and access caps shall be threaded to the body and shall not require the use of ferrous screws. The Pressure Reducing Valve shall be a WILKINS Model 600.